

FORMS

RM 1056 Madone chenille

Fréquence (Hz)	α	TR vide (s)	TR matériau (s)
100	0	10.9	11.15
125	0.01	11.44	11.2
160	0.05	11.61	10.56
200	0	11.39	12.01
250	0.01	11.99	11.62
315	0.03	11.48	10.79
400	0.07	9.62	8.52
500	0.1	8.68	7.49
630	0.14	8.19	6.81
800	0.26	7.33	5.47
1000	0.42	6.75	4.47
1250	0.47	6.67	4.24
1600	0.42	6.05	4.13
2000	0.51	5.95	3.85
2500	0.51	5.26	3.53
3150	0.52	4.42	3.12
4000	0.45	3.69	2.84
5000	0.5	3.1	2.42
6300	0.55	2.55	2.03

Table 1 : FORMS Madone chenille - RM 1056

Coefficient d'absorption et temps de réverbération avec et sans matériau en fonction de la fréquence par bande de tiers d'octave.

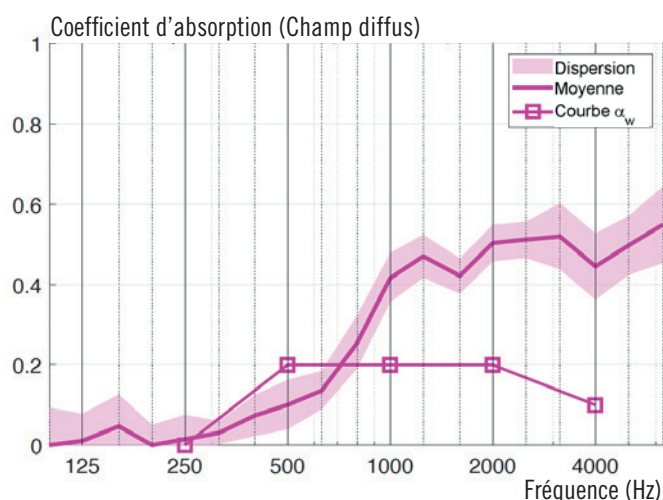


Figure 1 : FORMS Madone chenille - RM 1056

Coefficient d'absorption en champ diffus, dispersion et courbe de référence pour le calcul de l'indice unique α_{ω}

Fréquence (Hz)	α
250	0.02
500	0.10
1000	0.38
2000	0.48
4000	0.49
α_{ω}	0.20 (H)

Table 2 : FORMS Madone chenille - RM 1056

Coefficient d'absorption en fonction de la fréquence par bande d'octave et indice unique α_{ω}

FORMS

RM 1056 Madone chenille

Frequency (Hz)	α	TR empty (s)	TR mat (s)
100	0	10.9	11.15
125	0.01	11.44	11.2
160	0.05	11.61	10.56
200	0	11.39	12.01
250	0.01	11.99	11.62
315	0.03	11.48	10.79
400	0.07	9.62	8.52
500	0.1	8.68	7.49
630	0.14	8.19	6.81
800	0.26	7.33	5.47
1000	0.42	6.75	4.47
1250	0.47	6.67	4.24
1600	0.42	6.05	4.13
2000	0.51	5.95	3.85
2500	0.51	5.26	3.53
3150	0.52	4.42	3.12
4000	0.45	3.69	2.84
5000	0.5	3.1	2.42
6300	0.55	2.55	2.03

Table 1 : FORMS Madone chenille - RM 1056

Sound absorption coefficient and reverberation time with and without samples as a function of the frequency in third-octave bands.

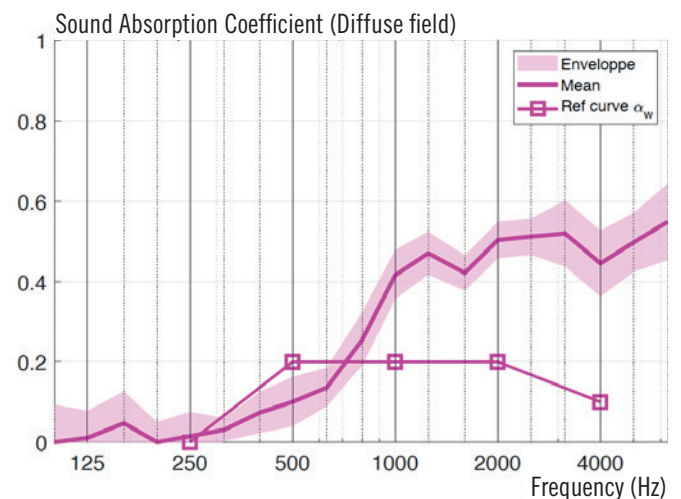


Figure 1 : FORMS Madone chenille - RM 1056

Sound absorption coefficient under diffuse field, envelope and reference curve for single-value indicator α_w

Frequency (Hz)	α
250	0.02
500	0.10
1000	0.38
2000	0.48
4000	0.49
α_w	0.20 (H)

Table 2 : FORMS Madone chenille - RM 1056

Sound absorption coefficient as a function of the frequency in octave bands and single-value rating α_w